ManualsPlus.com

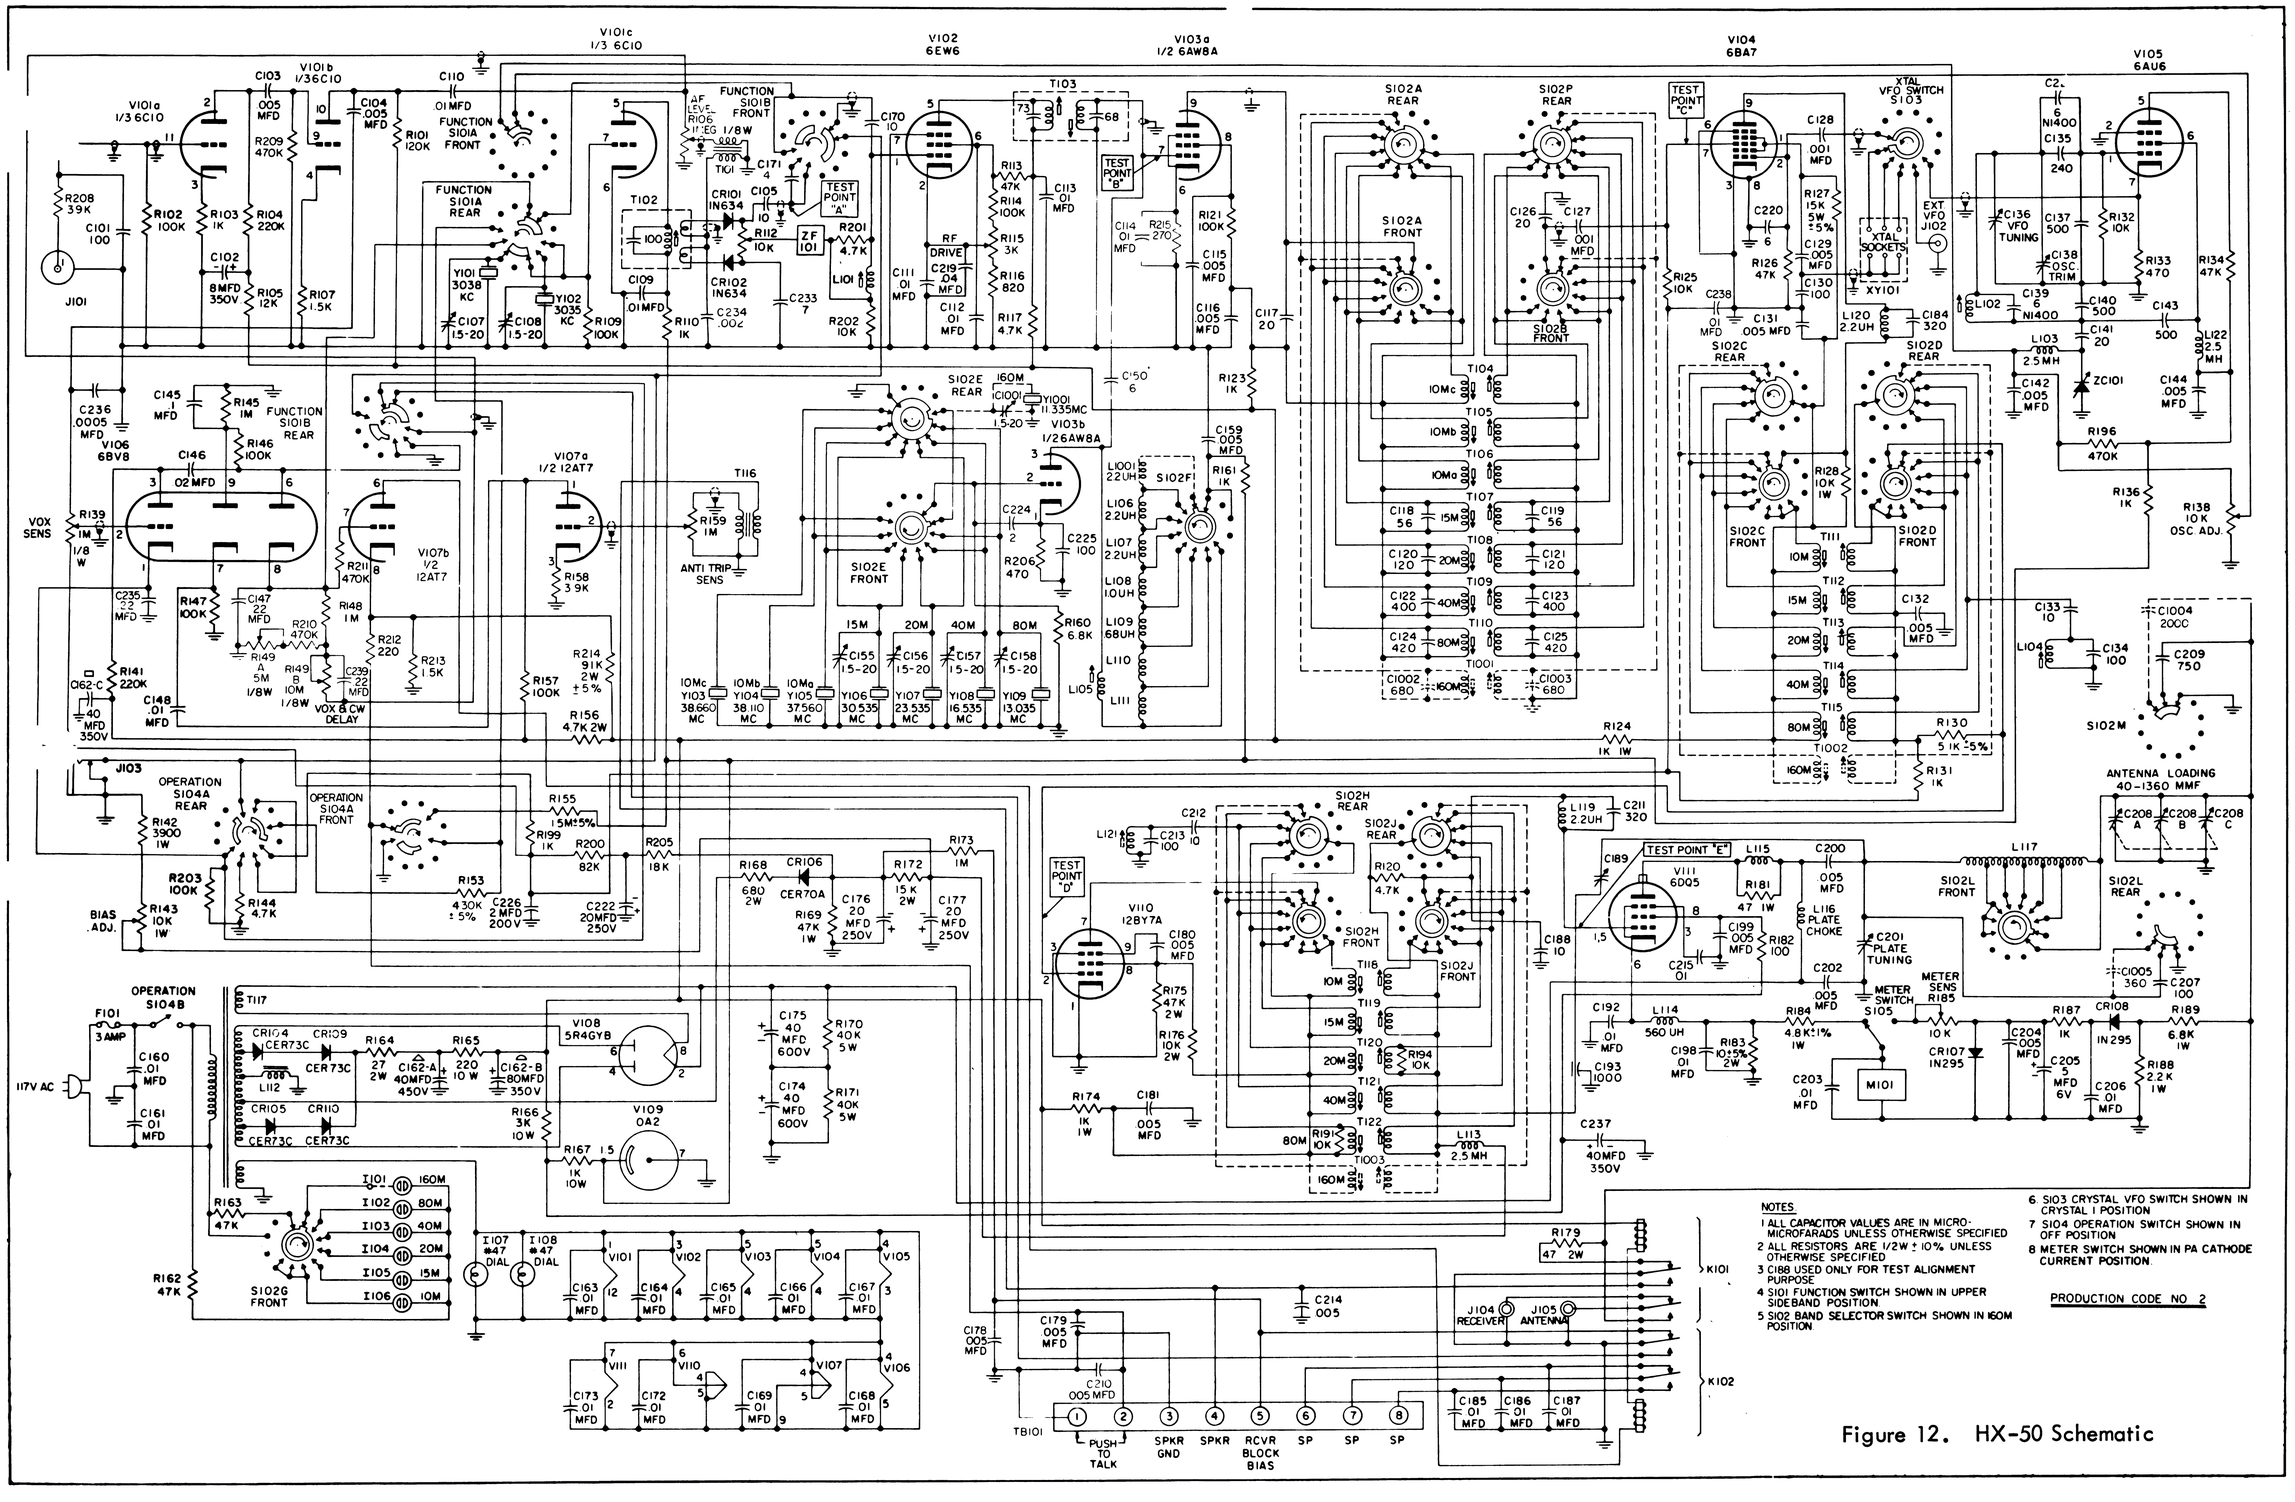


NOTES

1. ALL CAPACITOR VALUES ARE IN MICRO-MICROFARADS UNLESS OTHERWISE SPECIFIED
2. ALL RESISTORS ARE 1/2W ± 10% UNLESS OTHERWISE SPECIFIED
3. C188 USED ONLY FOR TEST ALIGNMENT PURPOSE
4. S101 FUNCTION SWITCH SHOWN IN UPPER SIDEBAND POSITION.
5. S102 BAND SELECTOR SWITCH SHOWN IN 160M POSITION
6. S103 CRYSTAL VFO SWITCH SHOWN IN CRYSTAL 1 POSITION
7. S104 OPERATION SWITCH SHOWN IN OFF POSITION
8. METER SWITCH SHOWN IN PA CATHODE CURRENT POSITION.

PRODUCTION CODE NO 2

Figure 12. HX-50 Schematic